
WILDFLOWER LEARNING COMMUNITY, Inc.

(for CUP APPROVAL)

single phase construction

3100 DAMASCUS CHURCH RD. CHAPEL HILL, NC

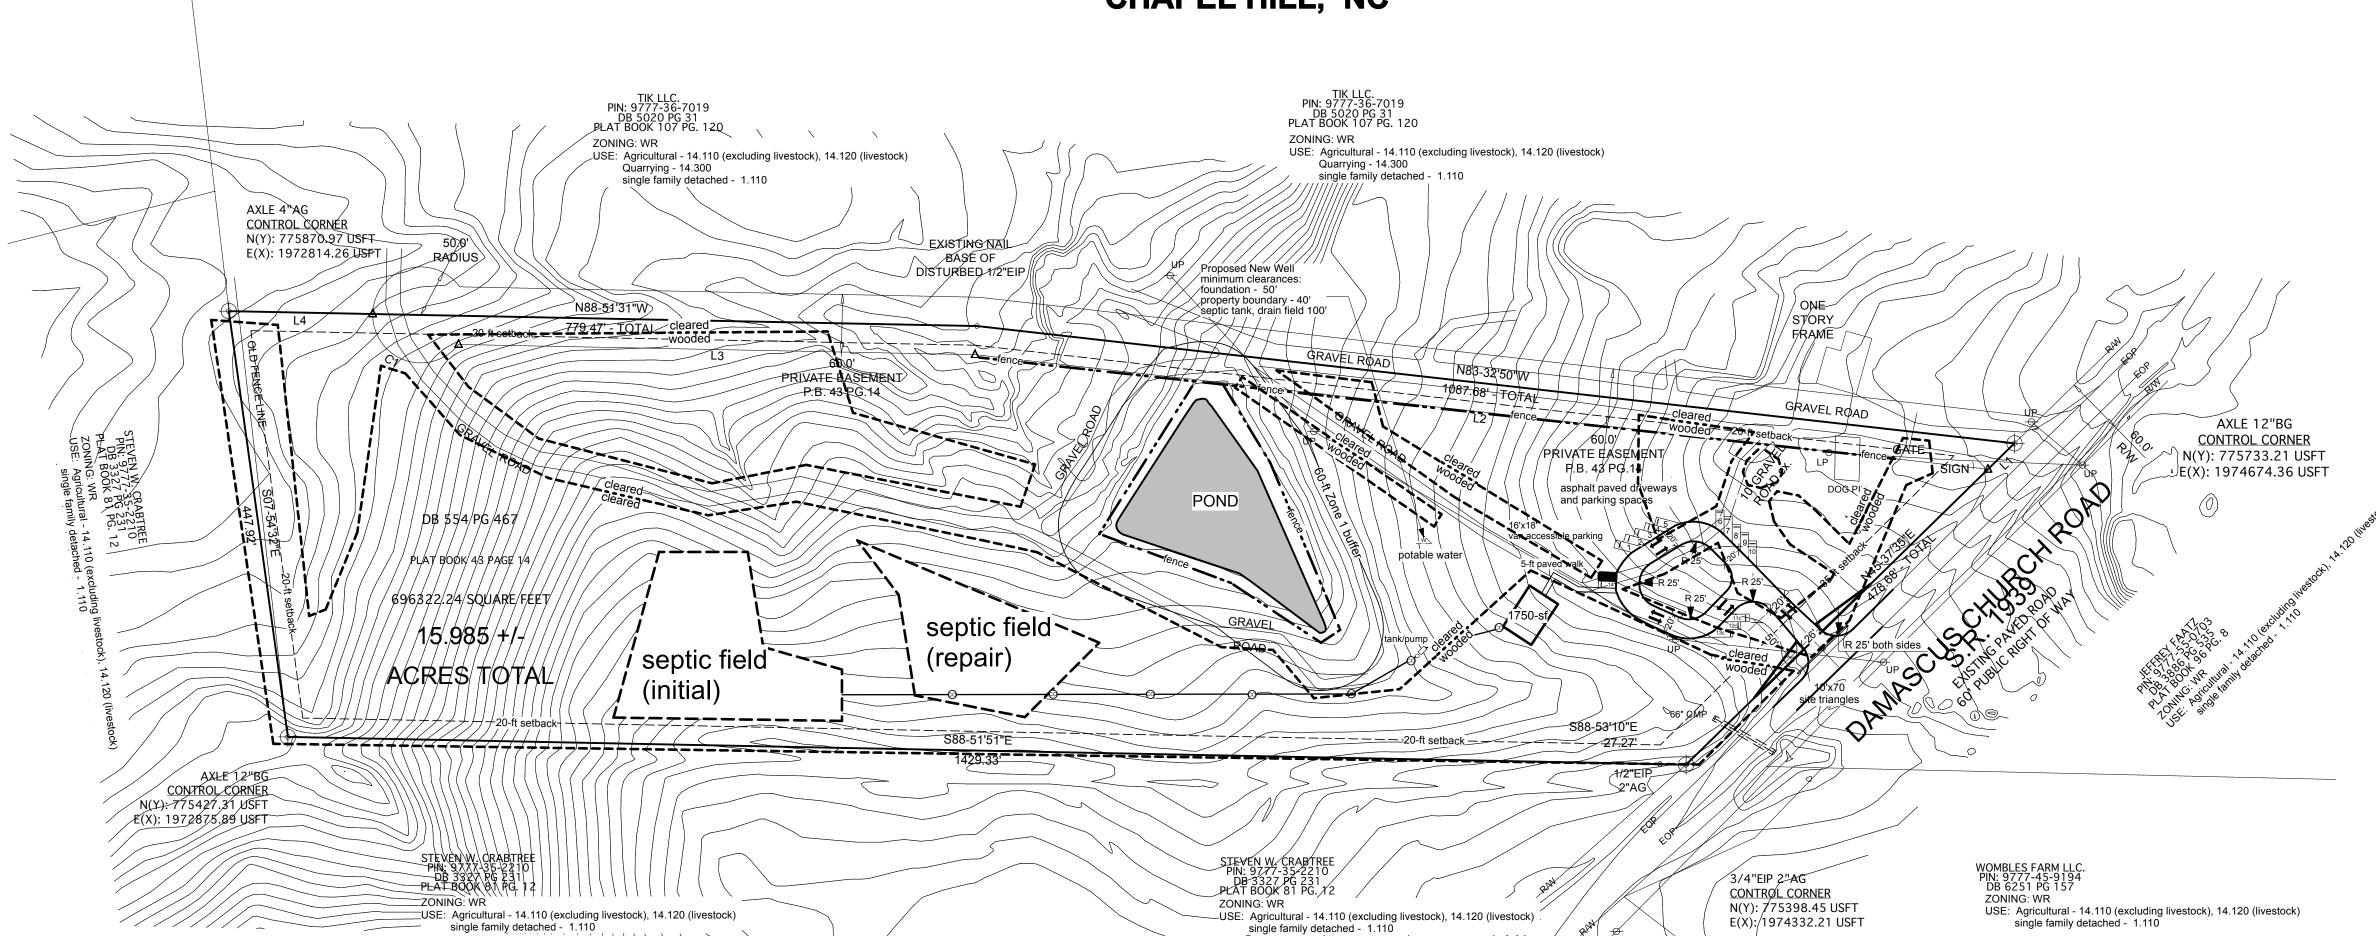

SUMMARY INFORMATION

NAME: Wildflowers LLC


PERMIT: CUP DEVELOPER(s): Wildflower Learning Community PIN: 9777-35-4538 ADDRESS: 3100 DAMASCUS CHURCH RD. **Chapel Hill, NC** LAND OWNER: Merritt, Betty J 4121 Hwy 87N Pittsboro, NC 27312 TRACT SIZE: 15.99A, 696,524-sf 4% area: 27,861-sf FLOOR AREA PROPOSED: 1,750-sf, single-story EXISTING IMPERVIOUS SURFACE: 36,266-sf (5.2%) (to be remediated) PROPOSED NEW IMPERVIOUS SURFACE: 14,367-sf AREA DISTURBED BY CONSTRUCTION: 21,321-sf EXISTING USE: Agricultural 14.110 (no livestock), 14.120 (livestock); currently fallow and unoccupied PROPOSED USE: 7.2 Child Care, 22.200 Child Day Care Facility Agricultural 14.110 (no livestock), 14.120 (livestock) **ZONE: WR, University Lake Critical SETBACKS** FRONT: 35-ft from R.O.W. SIGN: 17.5-ft from R.O.W. SIDE: 20-ft **HEIGHT: 40-ft max.**

Parking: 14 spaces required, none existing

HC van accessible: 1 @ 16'x18'

parking proposed:

Standard: 8 @ 8.5'x19' Compact: 5 @ 7.5'x16.5'

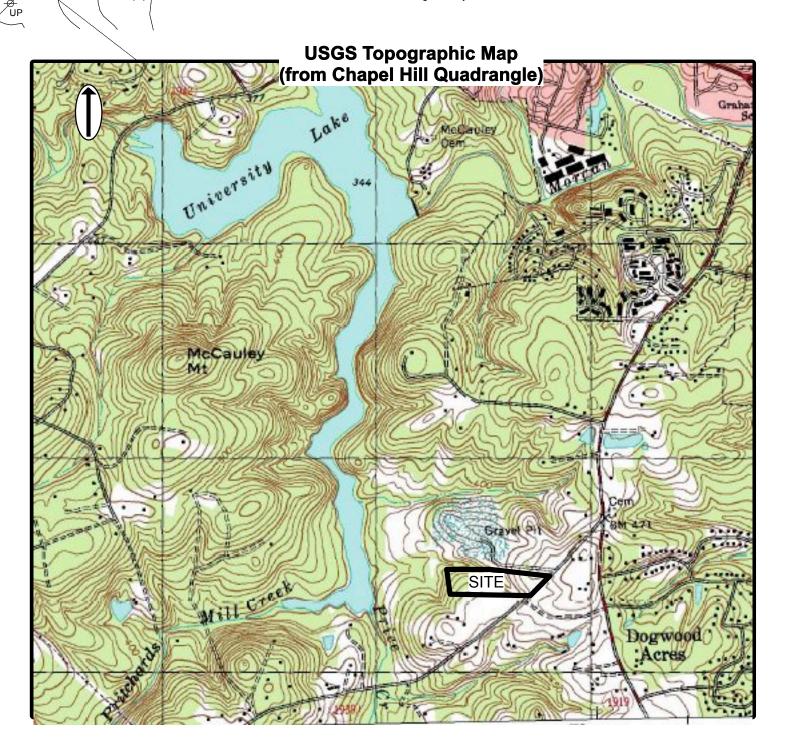

Architect/Designer:

SGI Technical Services (C-2092) Steven Addy, P.E. 200 North Greensboro Street Suite B-13A Carrboro, NC 27510 phone: (919) 942-7612 email: sgit@earthlink.net

Matthew S. Jarrell Land Surveying, PLLC

XXXXXXXXXXXXX Pittsboro, NC phone: (919) 932-0293 email: traverse3602@gmail.com

Table of Contents

Cover	Cover
EC-1	Existing Conditions
	Site Plan
SP-2	Tree Locations, Protection
	Grading and Drainage
	Utilities
C-3	Specifications, Details
	Erosion Contro
	Flevations

All topographic and boundary information is from survey drawings provided by Matthew S. Jarrel Land Surveying, PLLC, undated, from the Orange County GIS map, and from field measurements. A guarantee of accuracy is not implied or intended. Prior to beginning field activities, contractor should verify locations of all existing easements, utilities, structures, and other appurtances both aboveground and below. It will be contractor's responsibility to report deviations and either restoration. damages and site restoration.

PRELIMINARY NOT FOR CONSTRUCTION

SGI Technical Services (C-2092) 200 North Greensboro Street Suite B-13A Carrboro, NC 27510 phone: (919) 942-7612 email: sgit@earthlink.net

Project Name:

eveloper/Owner/Applicant:

WILDFLOWER LEARNING COMMUNITY, Inc. President: Shelley Riselvato 6205-F8 Farrington Rd. Chapel Hill, NC 27517


Drawing Title:


COVER


U	113.	
	Number	
	submittal 1	


Number	Description	Date
submittal 1	initial submittal	April 2018
submittal 2		
submittal 3		

Drawn by: SAA		
Checked by:	Sheet	1 _
	of	Cove
Date: 10 April 2018	Scale:	-

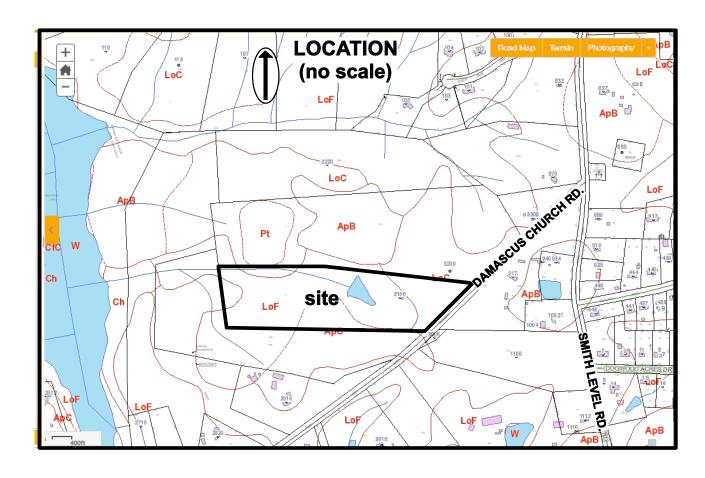

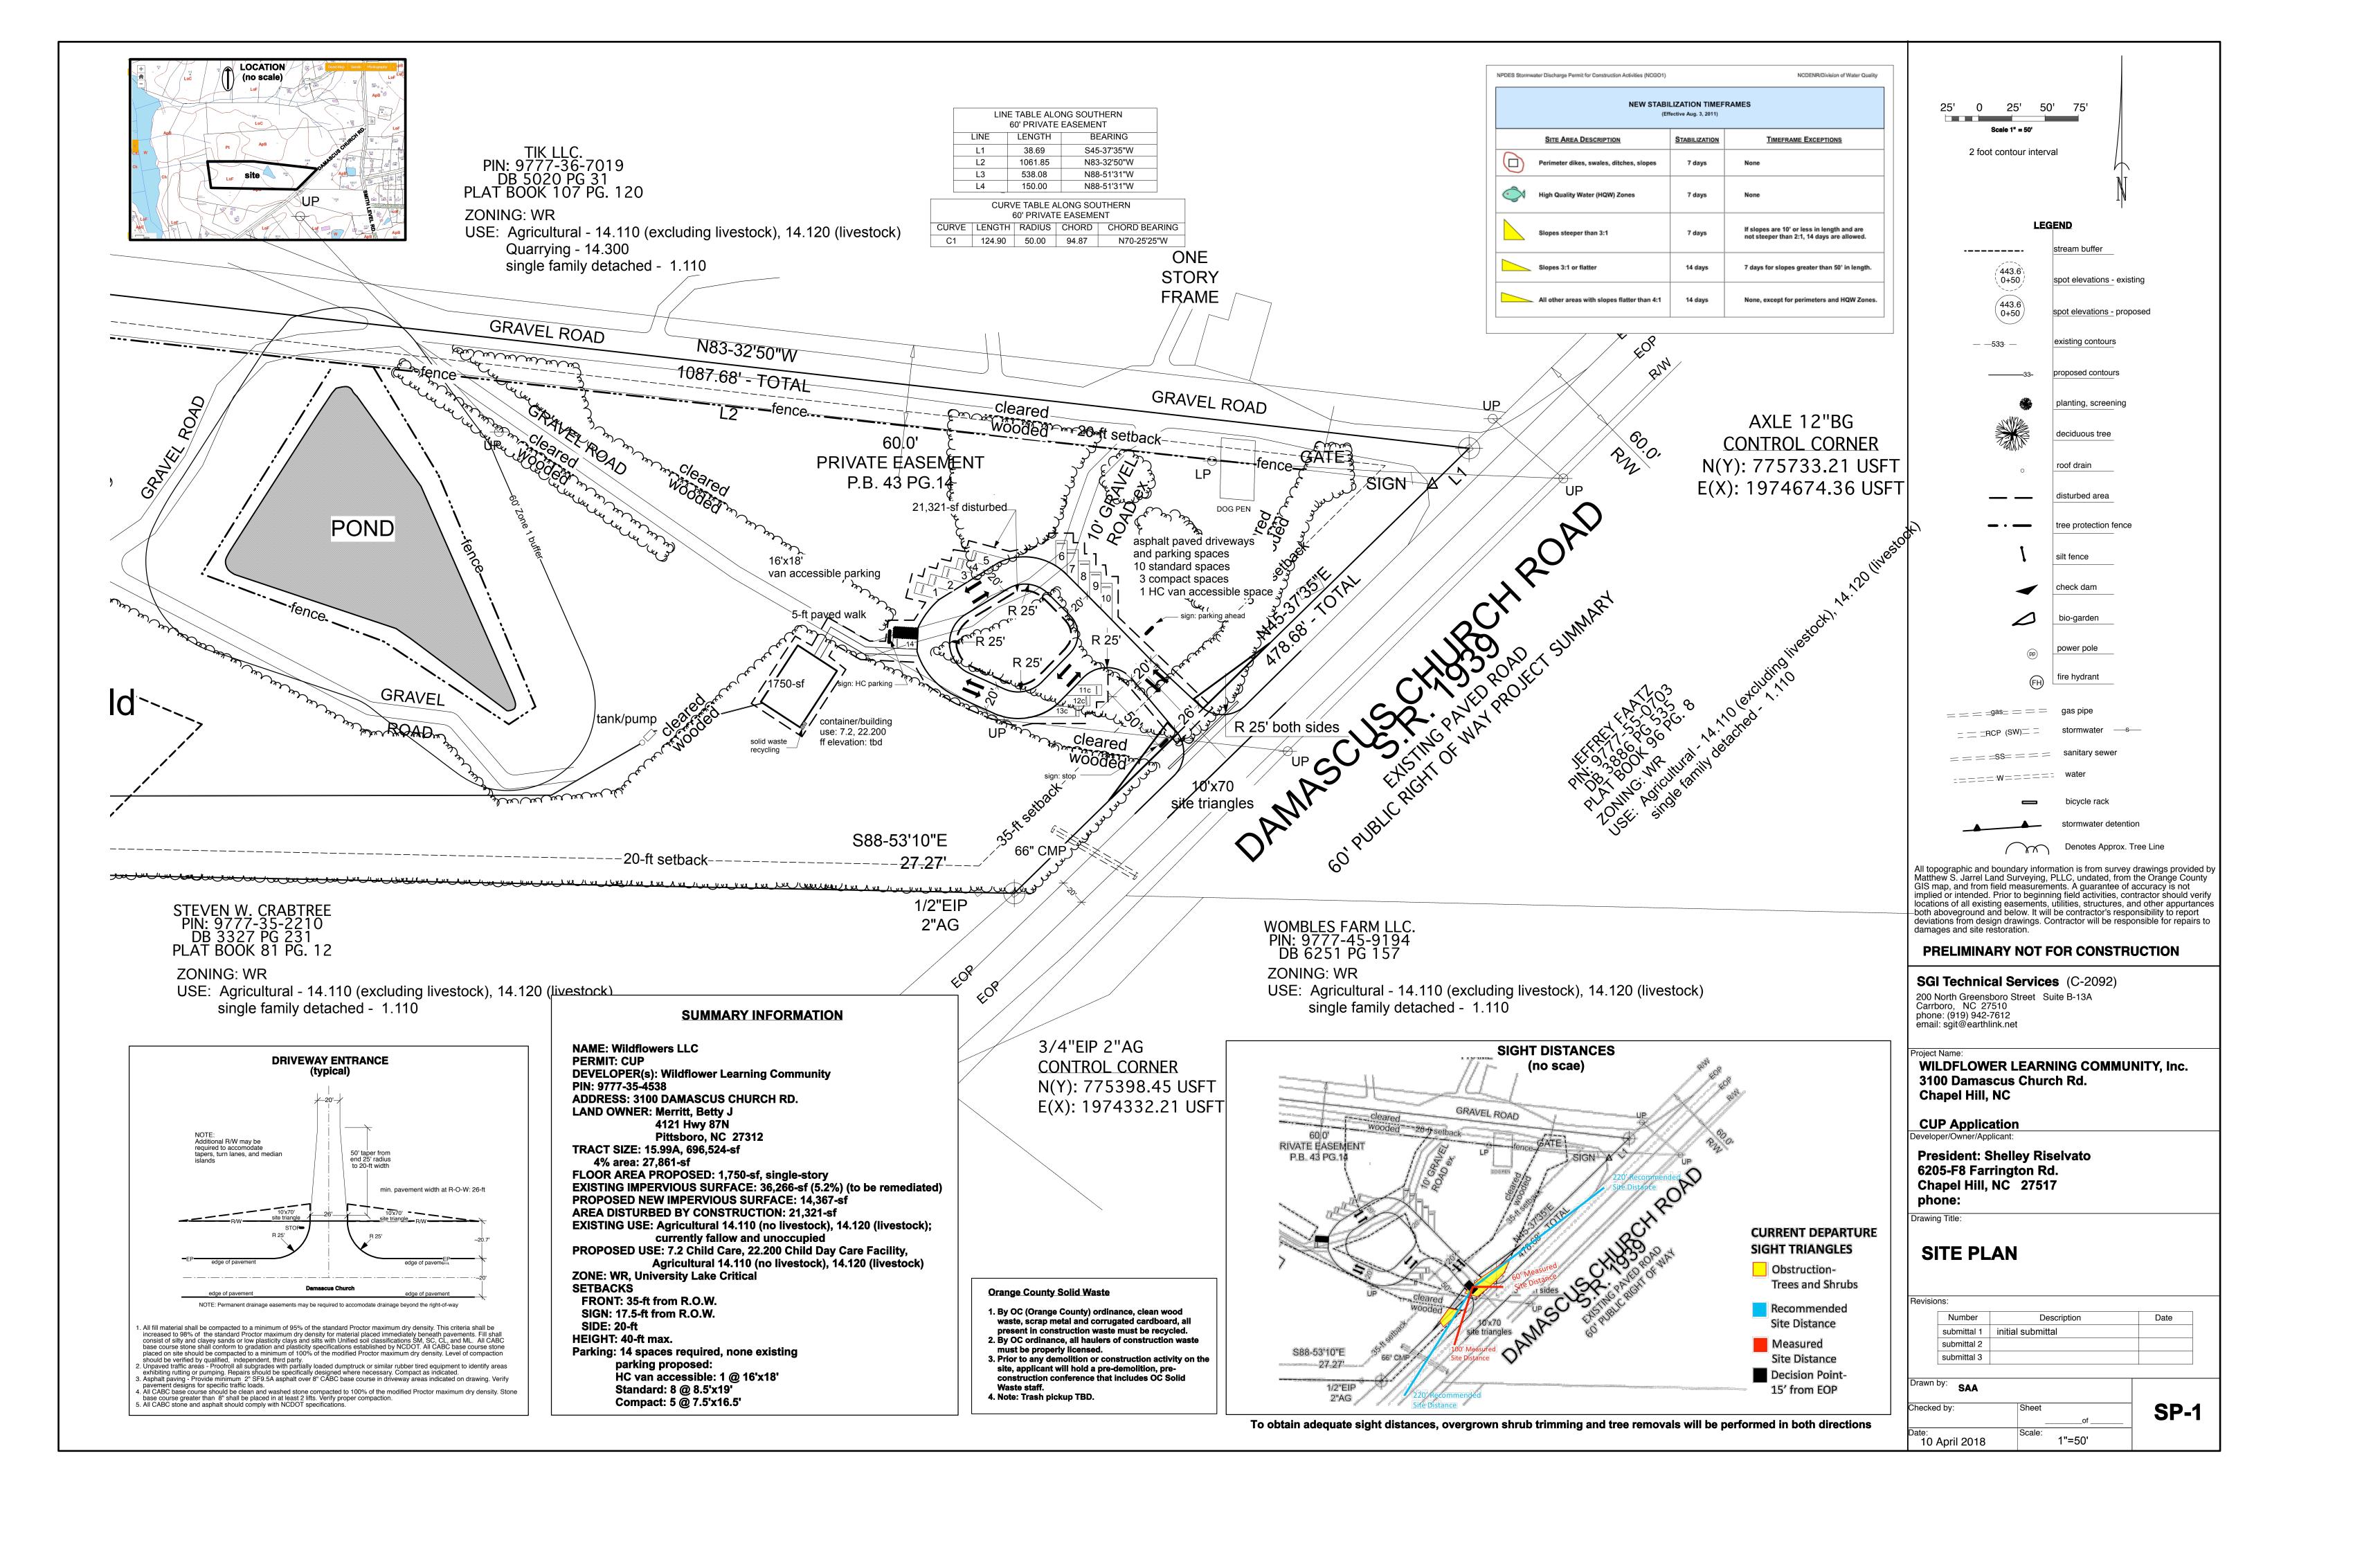

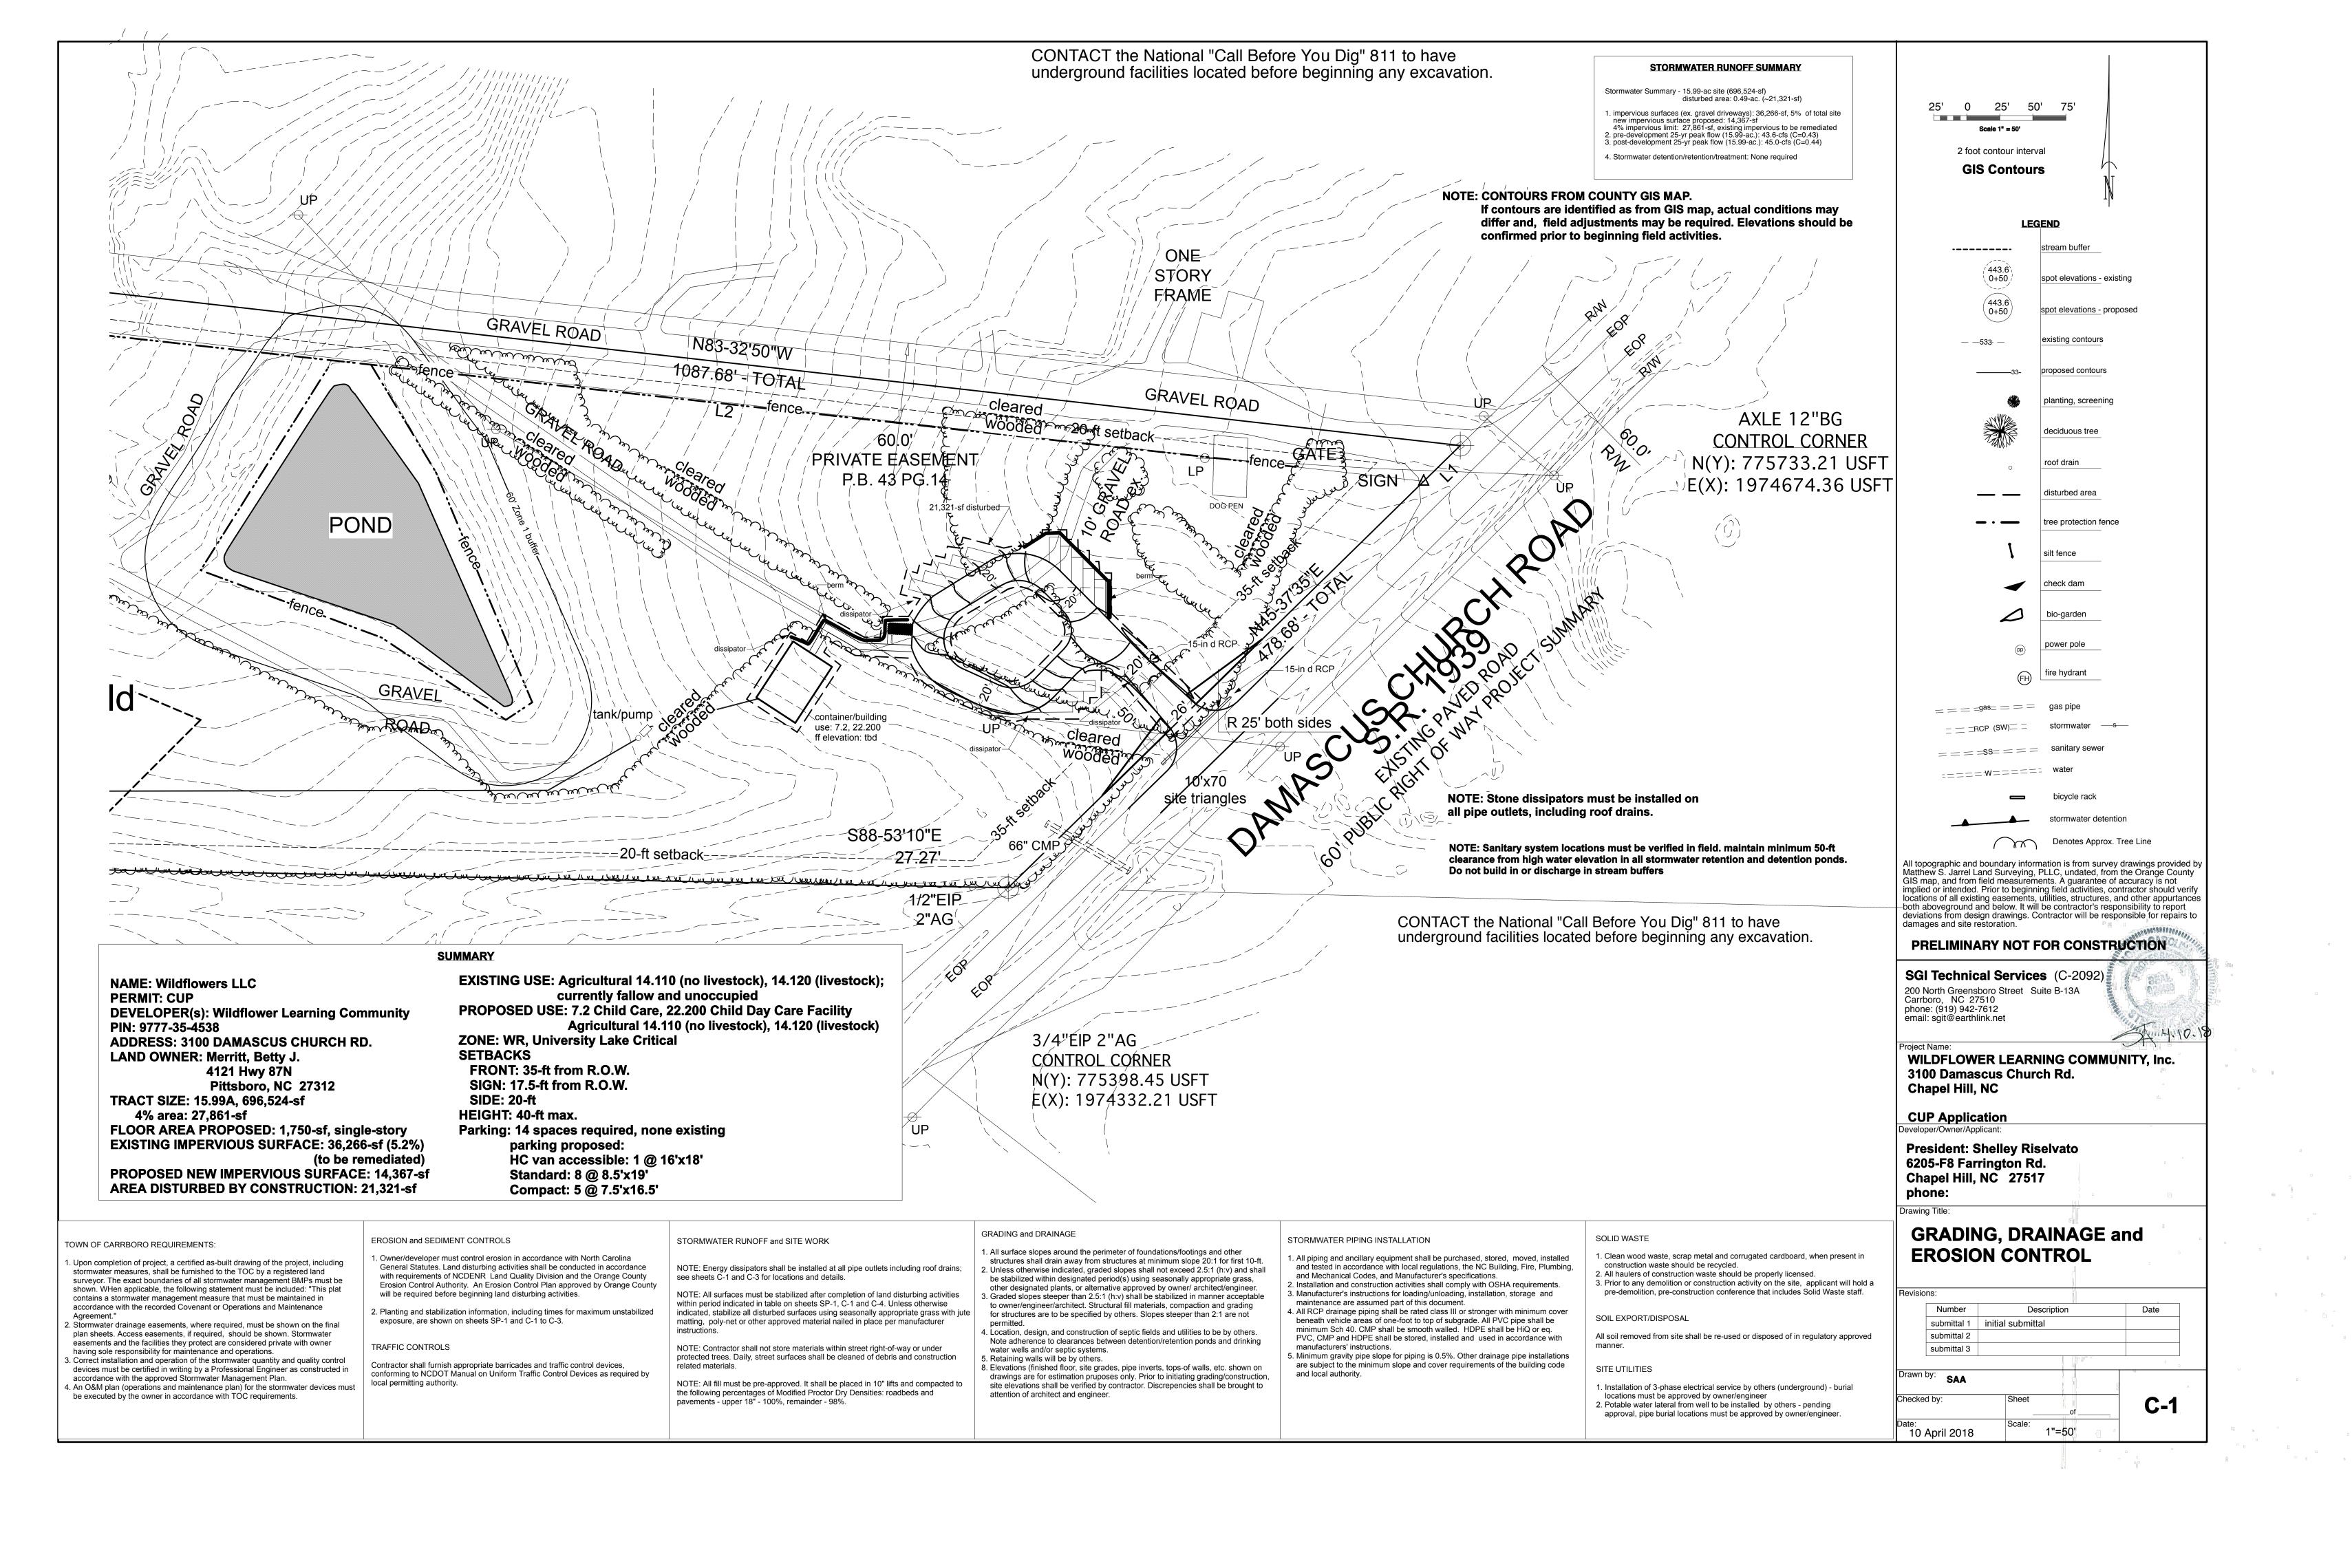

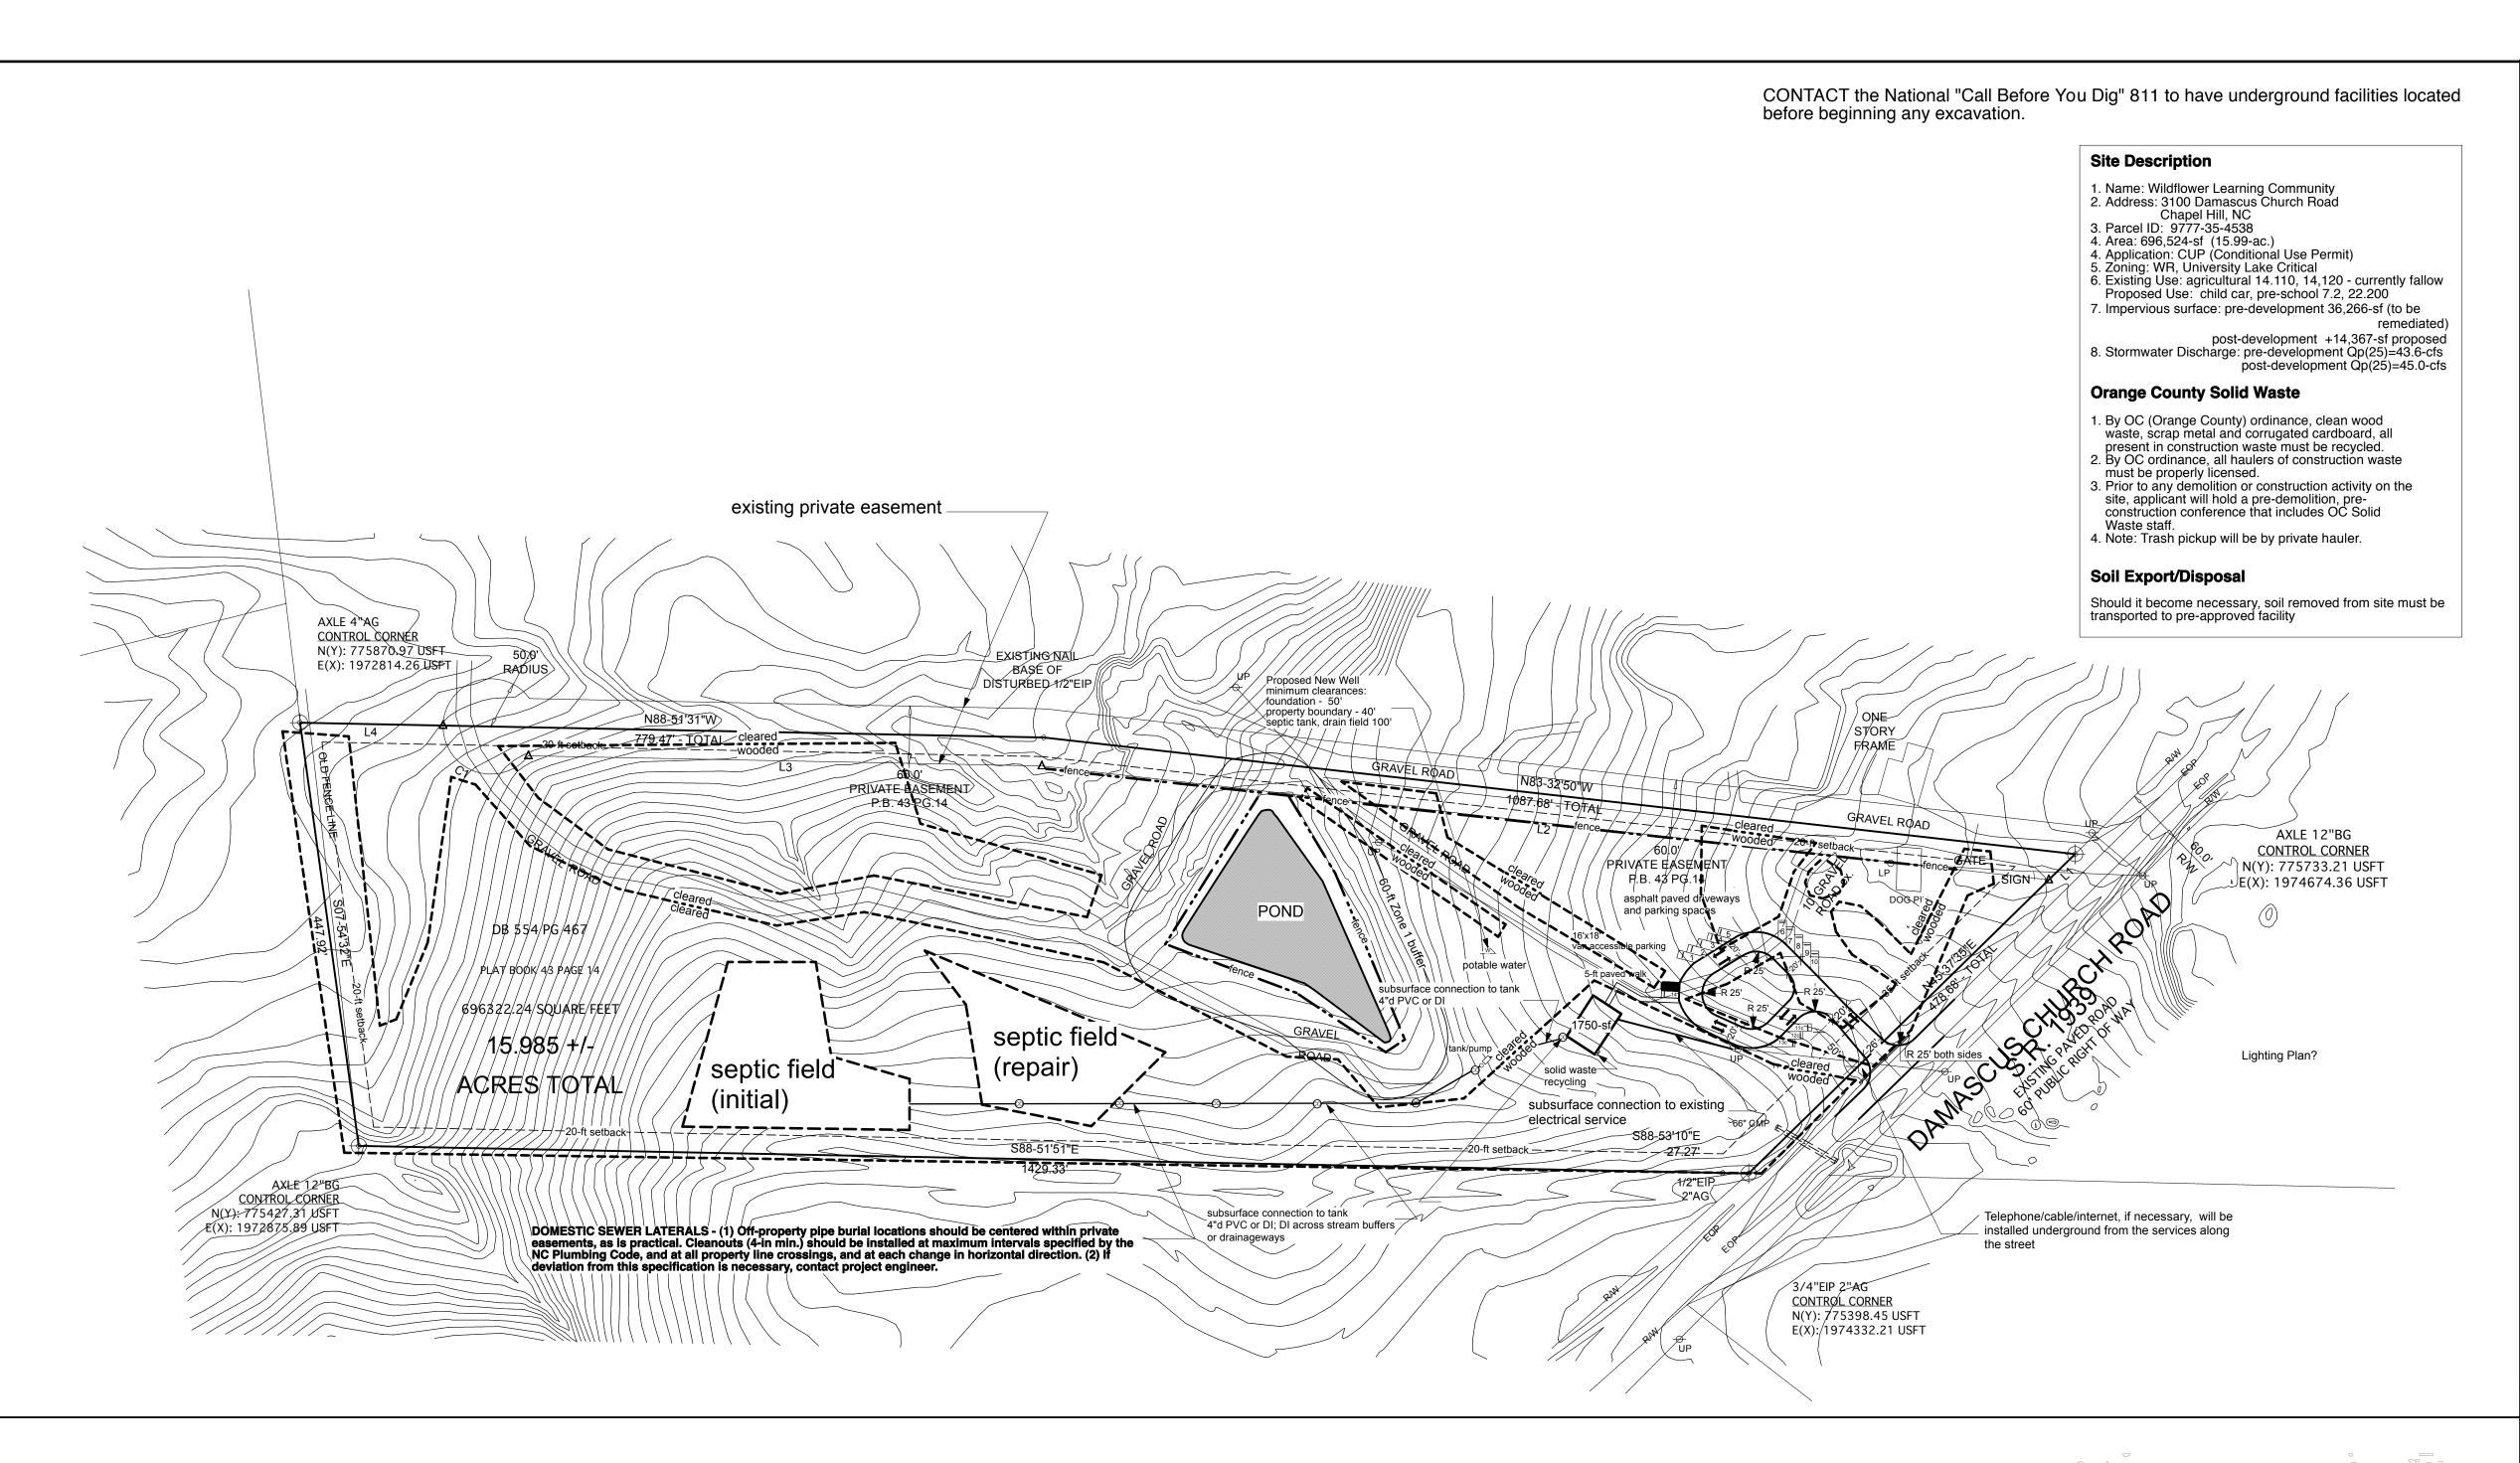

Town of Carrboro DPW

Developer/contractor shall maintain designated Construction Entrance to prevent and minimize the transportation of mud, stone and other construction related materials from being tracked off-site and onto street surfaces. All materials deposited upon referenced surfaces shall be removed immediately. Periodic street sweeping may be required.

Erosion and Sediment Controls

activities that could impact their future performance.

- Owner/developer must control erosion in accordance with NC General Statutes. Land disturbing activities shall be conducted in accordance with requirements of NCDENR Land Quality Division and the Orange County Erosion Control Authority. An erosion control permit from OCEC department is required in the watershed area when surface area disturbance exceeds 10,000-sf.
 Construction entrance(s) shall be constructed and silt fences installed as shown. Where applicable, future bio-garden areas should be protected by silt fences during construction activities unless designated as a temporary sediment control device. Bio-garden should be constructed after completion of sediment producing
- Power Lines and Poles

Construction activities near power poles and guide wires shall be performed in accordance with guidelines and specifications of Duke Power or other electrical utility provider. Installation, removal and relocation of power lines shall be coordinated with provider.

SEWER & WATER AUTHORITY

- 1. Please be advised that approval of this project, if any, is for compliance with certain policies, Standards and Specifications only. All other matters pertaining to this project are the responsibility of the owner or design engineer. The issuance of these plans does not preclude the responsibility of the developer, project engineer, contractor, or other agents or parties acting on their behalf, from full compliance with current Standards, Specifications and Procedures, or from complying with any and all statutes, rules regulations and ordinances, which may be imposed by other government agencies that may have jurisdiction. Violations
- may result in the approval being rescinded.

 2. Sewer Use Ordinance Discharge from this project must be in compliance with the local Sewer Use Ordinance. A grease interceptor shall be provided when one is necessary for the proper handling of wastewater containing excessive amounts of grease. All interception units must be of the type and capacity which is certified by the project engineer as meeting the requirements of local ordinances or the State of NC Building Code.

Site Utility Notes

Existing overhead power lines that will be re-used will be re-located underground where feasible
 Existing overhead power lines that will not be re-used will be removed as feasible.
 Where applicable, existing sewer/water service laterals and/or septic tanks will be removed.
 Locations of sewer and water service laterals can be adjusted to accommodate site conditions,
 A minimum spacing of 5-ft must be maintained between sewer and water service laterals.

min. 18-in vertical clearance between storm/roof drain piping and sewer/water services 6. Sewer manholes must have 0.2' fall from invert-in to invert-out.

Service Connections (sanitary sewer)

 Each building served must have a separate service connection. No common laterals will be allowed. Note that laterals must be inspected by the Town of Carrboro Inspections Department prior to burial. All stub outs must be plugged to prevent infiltration.

2. Service lateral connections shall be 4" diameter and constructed of approved PVC or ASTM A

- 746 Ductile Iron Pipe with compatible fittings and/or as specified. Minimum slope for 4" gravity drained pipe pipe shall be 1/4" per foot. Clean-outs shall be located at public R-O-W or easment line, straddling the easement, at all directional changes and at locations and intervals specified by NC Plumbing and Mechanical Code
 3. Green marking tape at least 2" wide with "sewer" marked on it should be placed 18" to 24" below final grade.
- 4. Locations of service laterals may be adjusted based upon field conditions; notify owner or owner's representative of all modifications to plan. The contractor will be responsible for any and all verification and/or relocation required as a result of changes in grades after sewer installation.
- installation.5. All pipe, materials and ancillary equipment shall be in accordance with NC Plumbing and Mechanical Code and local requirements. Loading/unloading, storage, handling, installation and operation shall be in accordance with NC Plumbing and Mechanical Code and manufacturer's
- All areas disturbed by utility installation shall be restored to original condition as agreed upon by owner and Town.

7. Surfaces should be graded to slope away from manhole covers and buildings.

General Utilities:

- Upon completion of project, information necessary to complete as-built drawings shall be provided to Project Engineer.
 Contractor is responsible for obtaining all permits and for coordinating project with Town of Carrboro.
- Water lines, tanks, manholes and sewer lines shall be installed and tested in accordance with current versions the State of North Carolina Plumbing Code, regulations of the North Carolina Department of Environment, Health and Natural Resources and local ordinances.
 Contractor shall be responsible for compliance with OSHA regulations and labor practices, especially as regards worker safety in excavations. Contractor is responsible for caving and all damages resulting thereof. All work shall conform to the best practices of the trade and standards set forth in the specifications and regulations cited.
 Contractor shall conduct field work in manner to minimize road obstructions. All work in
- roadway shall be coordinated with Department of Public Works. Fire hydrants, if any, must remain accessible. All utility construction or modification performed within the public right-of-way will require an encroachment agreement with the governing authority. All services shall be flush with the finished grade.

 6. All elevations and field conditions should be verified by contractor prior to beginning project.

 Discrepancies should be brought to the attention of ownerschitect/engineer. All design
- Discrepancies should be brought to the attention of ownerarchitect/engineer. All design changes must be pre-approved. Contractor shall identify and locate existing subgrade utilities and structures prior to beginning excavation. Contractor will be responsible for repairs to utilities or structures damaged as a result of field activities.

 7. An authorized Town representatives must inspect, review, and approve all materials for sewer lines and appurtenances prior to installation. A pre-construction conference with Town must be
- held prior to commencement of project.

 8. Pipe and materials shall be handled, unloaded, stored and installed per manufacturer's instructions. If there is any conflict between manufacturer's recommendations and Code specifications, the Code rules shall apply unless agreed upon between contractor and TOC representative. This shall not be interpreted as releasing contractor from specific minimum
- representative. This shall not be interpreted as releasing contractor from specific minimum requirements established by manufacturer.


 9. Contractor is responsible for establishing correct line and grade.

 10. When directed by the Project Engineer, ot the Town, unsuitable material shall be replaced to a suitable depth and width.
- 11. Pipe shall not be placed in water. Removal and proper disposal of water in trenches shall be the responsibility of contractor.
 12. All rock shall be excavated to a minimum depth of 6" below the barrel of the pipe. At least 6" clearance shall be provided on each side of pipe for the full depth of the excavation. #67 washed stone shall be placed in all areas where rock has been excavated.
- 13. Pipe shall be placed per Code instructions directly upon stone bedding. In no case shall pipe be brought to grade by blocking under the pipe barrel. Pipe shall be uniformly supported along its entire length. After it has been brought to grade, earth fill shall be placed carefully and tamped to hold pipe in position.


TOC SPECIFICATIONS . Utilities must be rinstalled by NC-licensed utility contractor.

5. Existing service lines must be disconnected from common service laterals

6. Construction drawings must be submitted to TOC for approval.

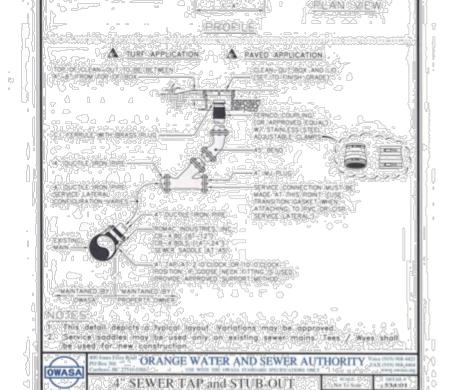

RANCOSAPPEICATION CLEVY, OUT !



LEGEND

stream buffer

spot elevations - existing

spot elevations - proposed

existing contours

proposed contours

planting, screening

deciduous tree

roof drain

disturbed area

tree protection fence

silt fence

check dam

All topographic and boundary information is from survey drawings provided by Matthew S. Jarrel Land Surveying, PLLC, undated, from the Orange County GIS map, and from field measurements. A guarantee of accuracy is not implied or intended. Prior to beginning field activities, contractor should verify locations of all existing easements, utilities, structures, and other appurtances both aboveground and below. It will be contractor's responsibility to report deviations from design drawings. Contractor will be responsible for repairs to damages and site restoration.

bio-garden

fire hydrant

PRELIMINARY NOT FOR CONSTRUCTION

SGI Technical Services (C-2092) 200 North Greensboro Street Suite B-13A Carrboro, NC 27510 phone: (919) 942-7612

email: sgit@earthlink.net

Project Name:

WILDFLOWER LEARNING COMMUNITY, Inc. 10.18

3100 Damascus Church Rd.

CUP Application

Chapel Hill, NC

WILDFLOWER LEARNING COMMUNITY, Inc.
President: Shelley Riselvato
6205-F8 Farrington Rd.
Chapel Hill, NC 27517

ving Title:

UTILITIES and LIGHTING

Checked by:

Sheet

Oate:

10 April 2018

Sheet


The sheet arrange of th


OWASA Approvals - Please be advised that OWASA approval of this project is for compliance with OWASA policies, standards and Specifications only.


All other matters pertaining to this project are the responsibility of the design engineer. The issuance of this letter does not preclude the developer, project engineer, contractor, or other agents or parties acting on their behalf, from full compliance with OWASA current Standards, Specifications and Procedures, or from complying with any and all statutes, rules regulations and ordinances, which may be imposed by other government agencies that


may have jurisdiction. Violations will result in the OWASA approval being rescinded.

Sewer Use Ordinance - Discharge from this project must be in compliance with the OWASA Sewer Use Ordinance. A grease interceptor shall be provided when in the opinion of OWASA it is necessary for the proper handling of wastewater containing excessive amounts of grease. All interception units must be of the type and capacity which is certified by the project engineer as meeting the requirements of OWASA.

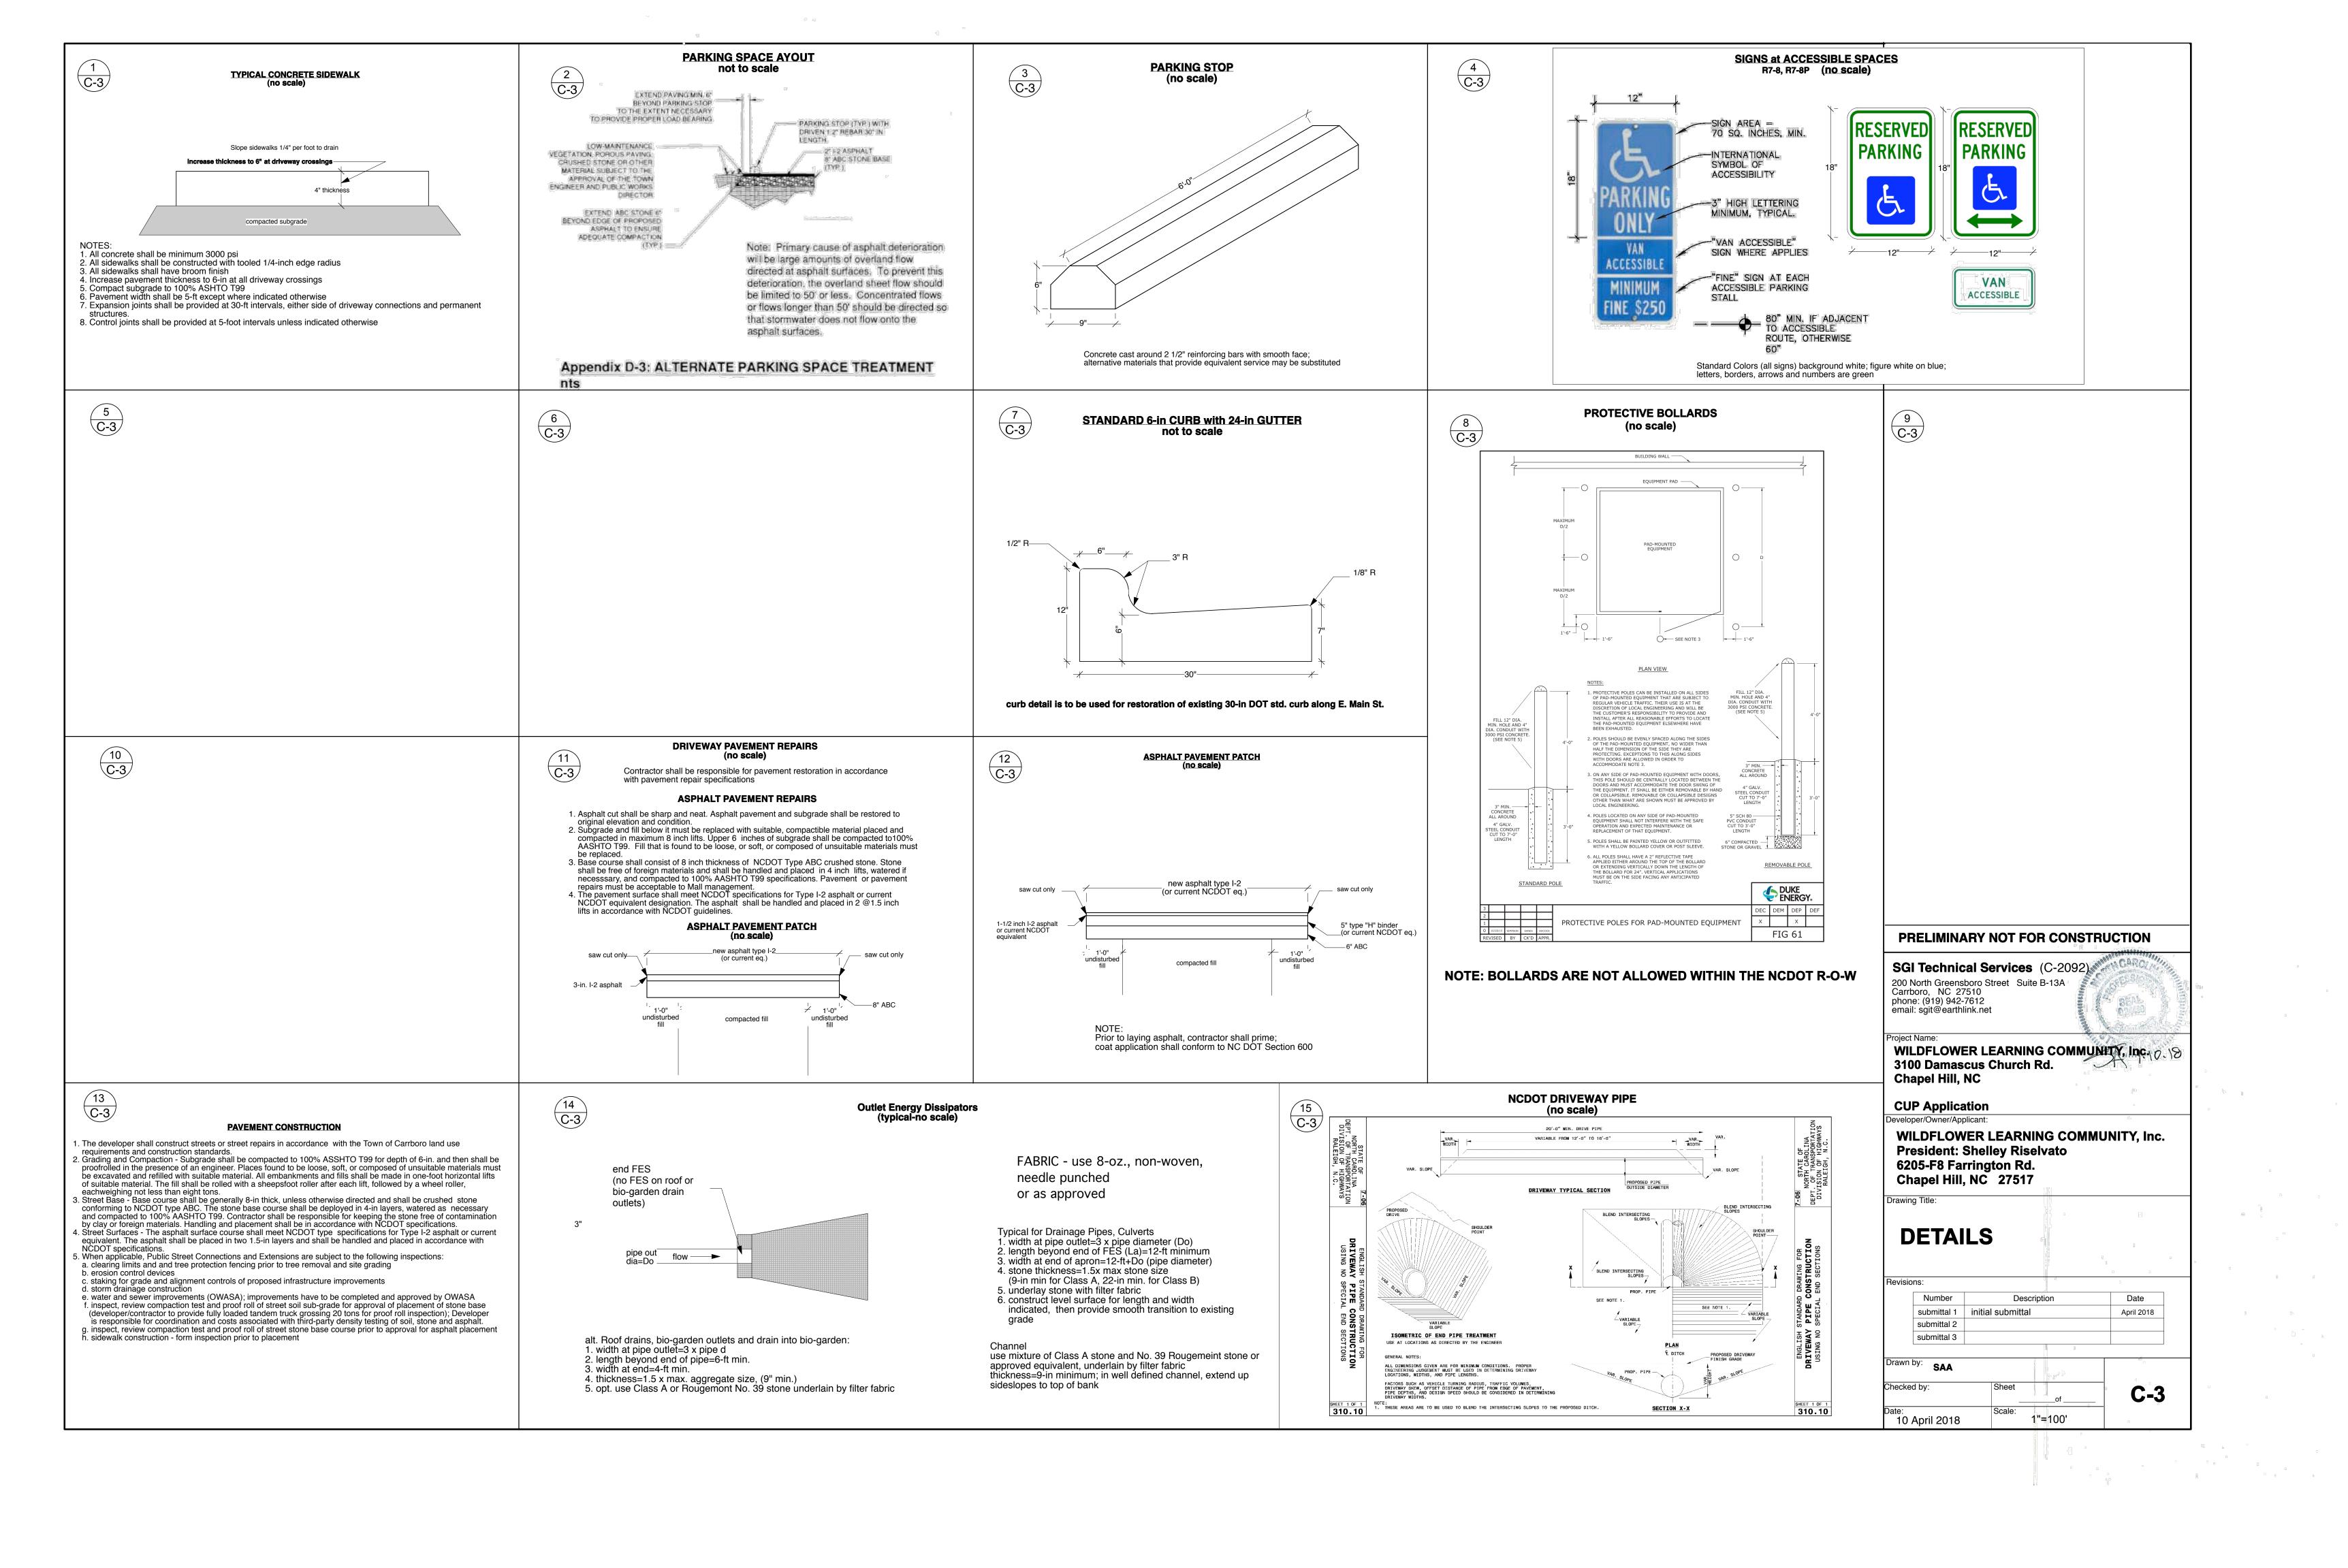


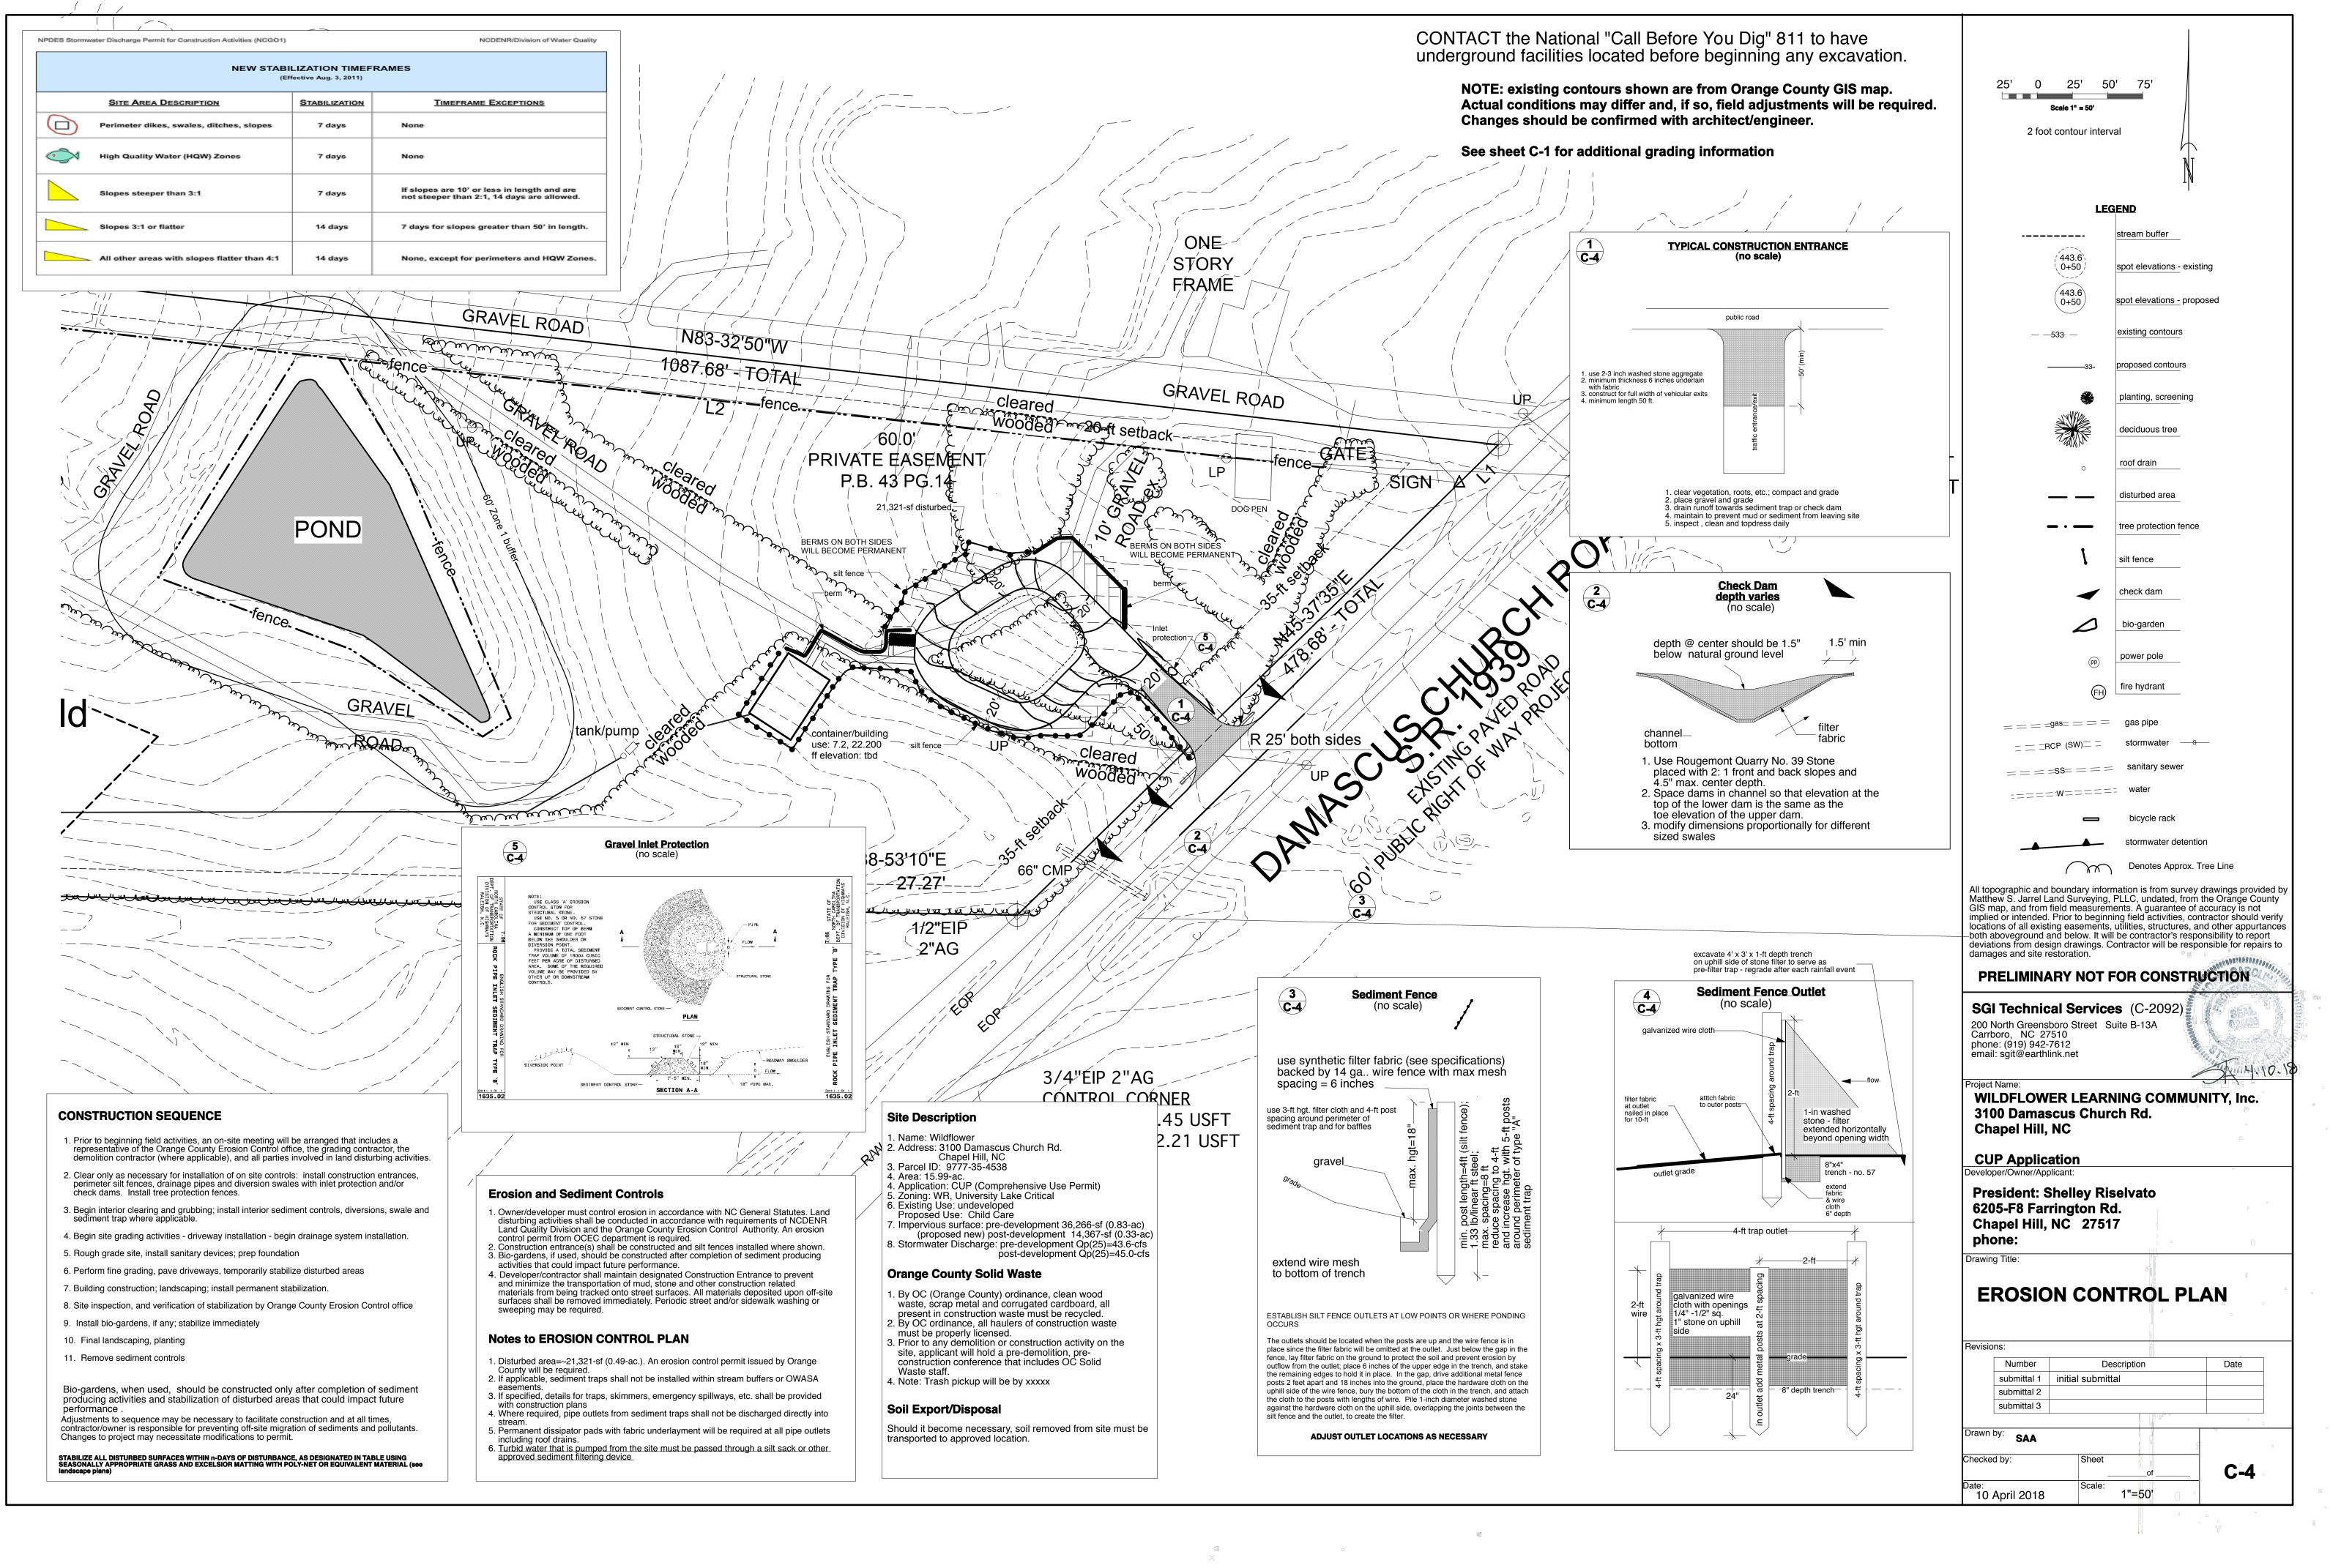



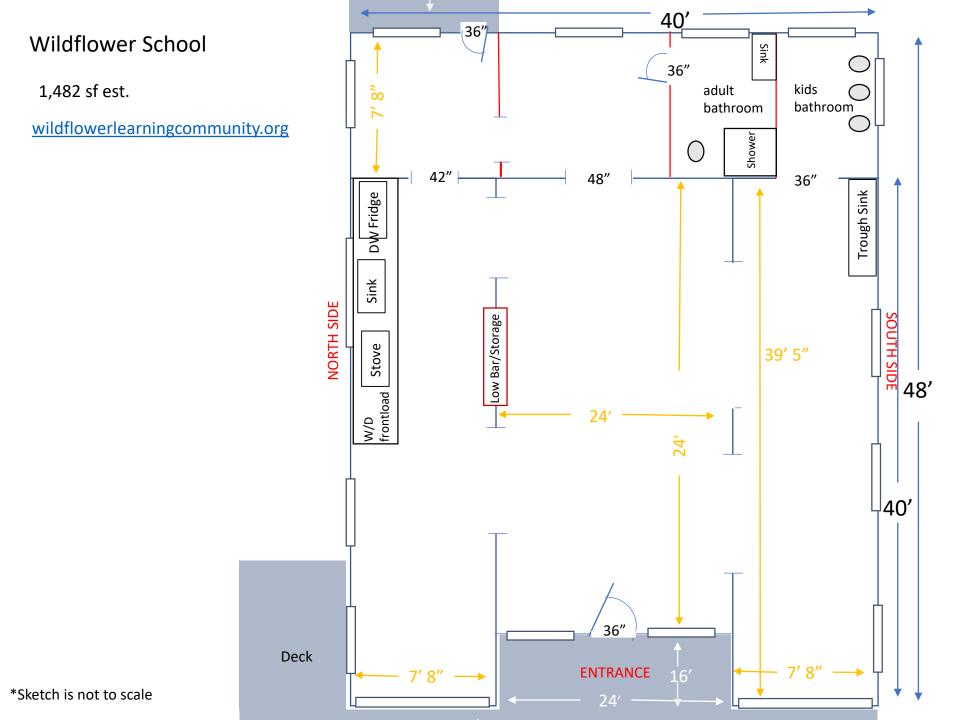

West Elevation (Building Entrance)

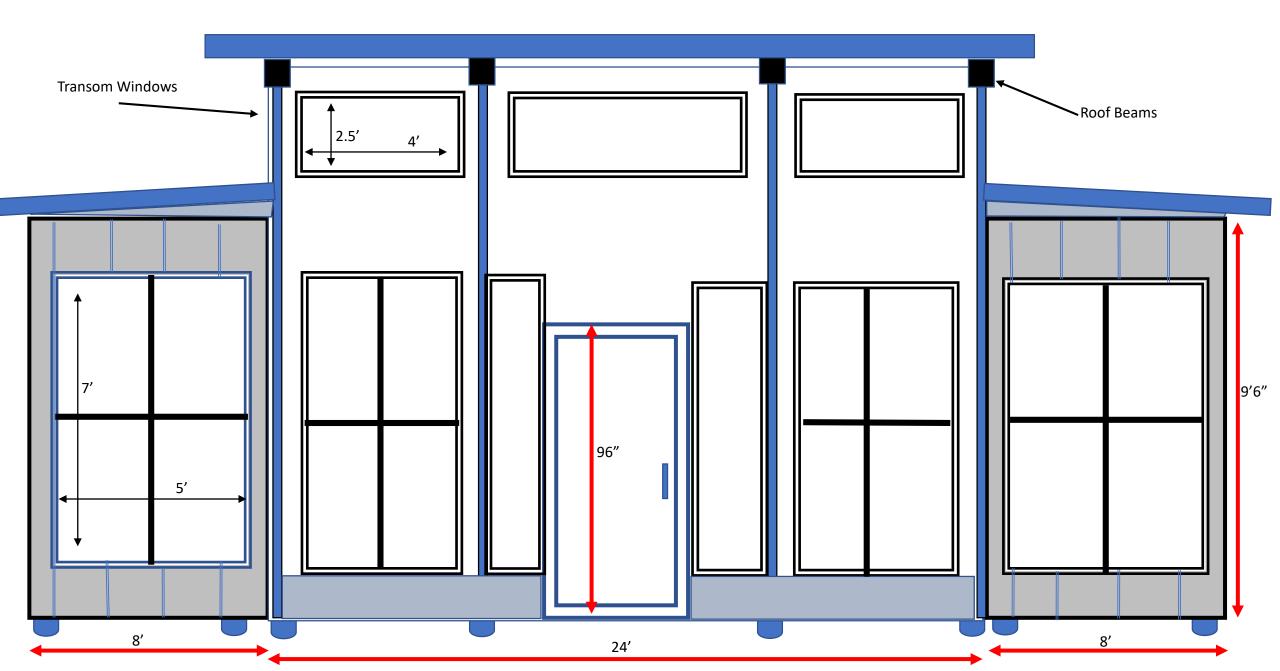

North Elevation

